



O'CONNOR · SUTTON · CRONIN  
MULTIDISCIPLINARY CONSULTING ENGINEERS

**E451: GLENAMUCK NORTH – SOUTHERN SITE**  
**SITE LIGHTING REPORT**

For  
**Durkan Glenamuck Developments Limited**  
10 December 2025

## NOTICE

This document has been produced by O'Connor Sutton Cronin & Associates for its client Durkan Glenamuck Developments Limited. It may not be used for any purpose other than that specified by any other person without the written permission of the authors.

## DOCUMENT CONTROL & HISTORY

OCSC Job No: <b>E451</b>	Project Code	Originator	Zone Volume	Level	File Type	Role Type	Number	Status / Suitability Code	Revision
	<b>E451</b>	<b>OCSC</b>	<b>XX</b>	<b>XX</b>	<b>RP</b>	<b>E</b>	<b>0001</b>	<b>S4</b>	<b>P01</b>

Rev.	Status	Authors	Checked	Authorised	Issue Date
P01	S4	SB	BF	BF	10/12/2025

## TABLE OF CONTENTS

<b>1</b>	<b>INTRODUCTION .....</b>	<b>3</b>
<b>2</b>	<b>PROPOSED DEVELOPMENT .....</b>	<b>4</b>
<b>3</b>	<b>THE DESIGN.....</b>	<b>6</b>
	<b>EXTERNAL LIGHTING:.....</b>	<b>6</b>
	<b>BIODIVERSITY STRATEGY .....</b>	<b>6</b>
	<b>DETAILED STRATEGY .....</b>	<b>7</b>
	<b>LUMINAIRES .....</b>	<b>8</b>
	<b>LIGHT SPILL INTO RESIDENTIAL UNITS .....</b>	<b>8</b>
<b>4</b>	<b>SUMMARY .....</b>	<b>11</b>
<b>5</b>	<b>APPENDIX A – SITE DRAWING.....</b>	<b>12</b>
<b>6</b>	<b>APPENDIX B – SITE CALCULATION REPORT WITH LUMINAIRE DATASHEETS- .....</b>	<b>13</b>

# 1 INTRODUCTION

This report outlines the design criteria and considerations considered regarding the lighting scheme within the proposed Development on lands within the townland of Glenamuck North in Kilternan, Dublin 18.

It has been prepared in conjunction with a planning application to Dun Laoghaire-Rathdown County Council. The report considers the preliminary lighting design as developed by O'Connor Sutton Cronin (OCSC) and should be read in conjunction with OCSC drawing no. E451-OCSC-XX-XX-RP-E-0001- S4-P01.

The external lighting within the proposed development area will be primarily be taken in charge. The drawings and calculations submitted are to demonstrate the lux level averages across the development are meeting the standard set out by DLRCC for public lighting.

All proposed lighting has been designed and specified to comply fully with the Council's standard specification document.

Details of the luminaires proposed, on which the detailed design has been based, are contained in the appendices to this document.

The predicted performance of the external lighting installations has been assessed in detail using Lighting Simulation software. The Lighting Simulation software used was LIGHTING REALITY.

Standards and guidelines in relation to the lighting design are:

- BS 5489-1-2013 Design of road lighting of roads and public amenity areas. Code of practice (Published on : 31<sup>st</sup> May 2020 by BSI Standards Limited 2020)
- I.S. EN 13201-2-2015 Road lighting - Performance requirements (Published on: 31<sup>st</sup> Jan 2016 by BSI Standards Limited 2016)
- Dun Laoghaire-Rathdown County Council Public Lighting Specification

The electrical services for the external lighting installation will be designed in accordance with NSAI National Rules for Electrical Installations.

## 2 PROPOSED DEVELOPMENT

The subject site relates to lands within the townland of Glenamuck North in Kilternan, Dublin 18. The site is generally bounded by: the recently constructed Glenamuck District Distributor Road to the north (to be known as the Kilternan Road); the under construction Glenamuck Link Distributor Road to the east (to be known as the Kilternan–Glenamuck Link Road); Glenamuck Manor and a residential dwelling (known as 'Westgate'), its associated outbuildings and wider land holding to the south; and a residential dwelling (known as 'Shaldon Grange') and its wider landholding located to the west.


Road works are proposed to the approved Glenamuck District Roads Scheme (ABP Ref. HA06D.303945) to provide access to the development from the Kilternan Road. The Kilternan Road access point will include works, inclusive of any necessary tie-ins, to the footpath and cycle track to create a side road access junction incorporating the provision of uncontrolled pedestrian and cyclist crossing across the side road junction on a raised table. A surface water outfall pipe (225 mm) is also proposed to pass through land to the north of the site, including the future Kilternan Road. The total site area including the development site, road works and infrastructure works measures c. 3.32 Ha.

The development will principally consist of the construction of 135 No. residential units, comprising 65 No. houses (9 No. 2-bed units, 46 No. 3-bed units and 10 No. 4-bed units) and 70 No. duplex units (21 No. 1-bed units, 22 No. 2-bed units and 27 No. 3-bed units). The proposed development will principally range in height from 2 No. to 4 No. storeys.

The development also provides: car parking spaces; bicycle parking; bin storage; ancillary storage; private balconies, terraces and gardens; hard and soft landscaping; boundary treatments; lighting; substations; and all other associated site works above and below ground.



*Figure 1 – Proposed Site Location (main site area outlined only)*

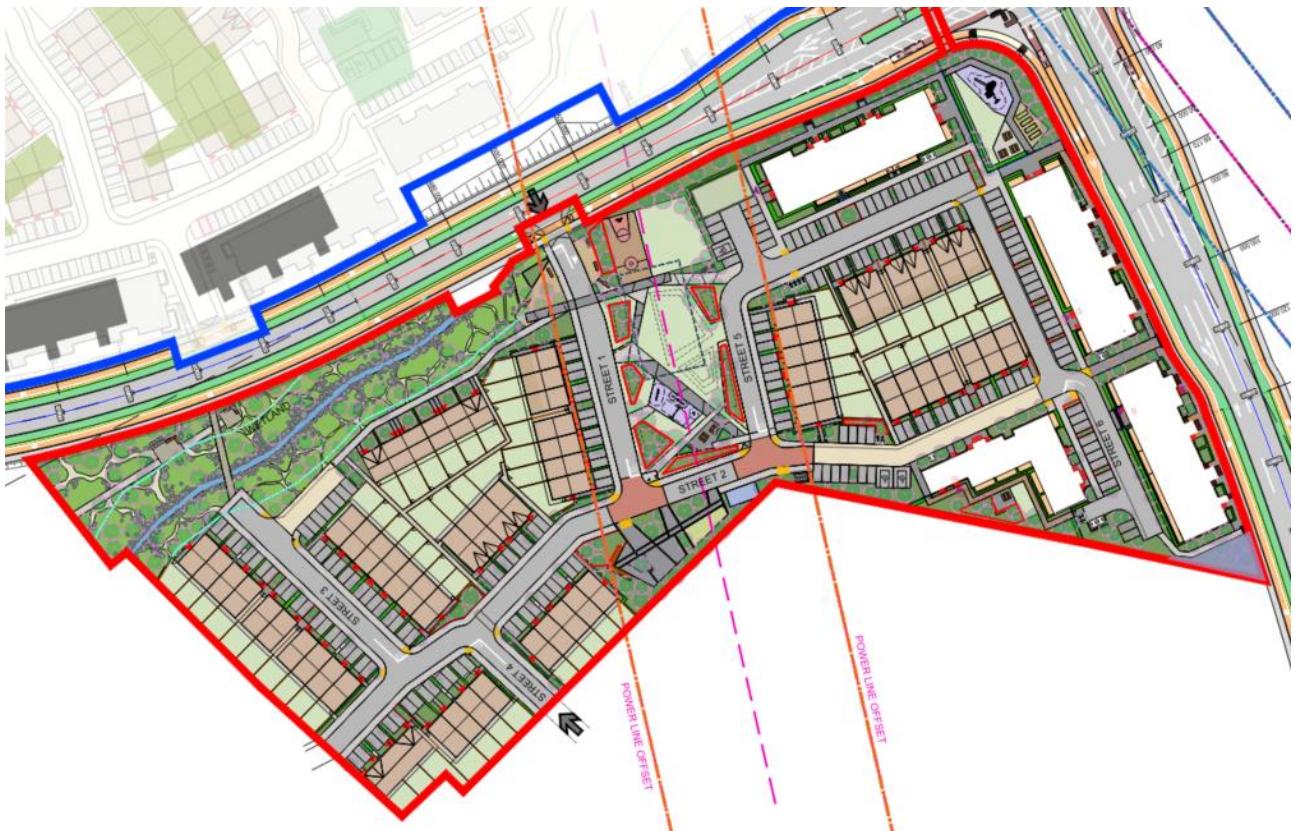

**Figure 2 – Proposed Site Layout**

## 3 THE DESIGN

### EXTERNAL LIGHTING:

The external lighting has been designed in the best possible way for visual comfort, biodiversity, and suitability, and shall be specified in accordance with the appropriate maintained illuminance levels recommended by the following documents:

- EN13201-2-2015 Lighting Classes for external lighting. (Published on: 31<sup>st</sup> Jan 2016 by BSI Standards Limited 2016)
- BS EN 12464-2 Outdoor workplaces (Published on: 31<sup>st</sup> Jan 2014 by BSI Standards Limited 2014)
- BS 5489-1-2020 Design of road lighting of roads and public amenity areas. Code of practice (Published on: 31<sup>st</sup> May 2020 by BSI Standards Limited 2020)
- BS EN 13201-2 Lighting Classes for external lighting. (Published on: 31<sup>st</sup> Jan 2016 by BSI Standards Limited 2016)
- CIBSE Lighting Guide 6 - The Outdoor environment (Published on: Jan 2016 by CIBSE publications)
- Institute of Lighting Professionals (ILP) Guidance notes for the reduction of obtrusive light. (Published on: Jan 2020 by Institution of Lighting Professionals publications)
- Dun Laoghaire-Rathdown County Council Public Lighting Specification
- GUIDE ON THE LIMITATION OF THE EFFECTS OF OBTRUSIVE LIGHT FROM OUTDOOR LIGHTING INSTALLATIONS, 2ND EDITION
- DLR County Development Plan

Lighting design shall ensure that:

- all night-time lighting is concentrated in the appropriate areas.
- upward lighting is minimised.
- light pollution is minimised.
- energy consumption is minimised.
- To enhance security

### BIODIVERSITY STRATEGY

Please refer to the ecological detail submitted with this application for detail. It is widely recognised that artificial lighting can have detrimental effects on nocturnal animals, therefore, the development lighting strategy has considered the following: -

- **Do not over light** - Where relevant guidance gives a range of illumination levels the lowest one which is appropriate shall be utilised. No lighting is proposed along the riparian corridor to protect bats and preserve dark corridors.
- **Luminance distribution** - The spread of light shall be kept near to or below the horizontal where possible.
- **Minimise UV light** - Selected luminaires shall emit minimal UV light. This can be achieved by selecting LED luminaires.
- **Lighting controls** – Consideration shall be made to when lighting is operational to reduce detrimental impacts on nocturnal animals.

## DETAILED STRATEGY

The lighting design has been designed to complement each individual space. Figure 3 below is the proposed typology lighting strategy plan for the proposed site.



*Figure 3 – Proposed Typology Lighting Plan for proposed site*

### Zone 1 – Residential Roads

The lighting strategy for the residential roads is to design to P4 classification to reduce the impact of the lighting on the residential buildings but to focus on the roads for safe driving within the development.

The streetlights in these areas will be placed on lighting column at a height of 6m.

The lighting strategy shall endeavour to reduce the light intrusion into the windows in accordance with the ILP Guidance Notes for the Reduction of **Obtrusive** Light.

### Zone 2 – Pedestrian Walkway

The lighting strategy for the pedestrian walkway is to design to P4 classification to provide sufficient lighting for safety, whilst also ensuring an attractive night-time environment to allow users to navigate the main routes safely. External lighting columns will be situated along the main pedestrian areas to focus on the safe navigation across the main footpaths, whilst not over lighting the surrounding area.

The relevant lighting classes have been determined by using CEN/TR 13201-1:2015. The following table outlines the allocated classes based on the development typology plans outlined within section.

### **Zone 3 – Site Entrance**

The lighting strategy for the residential entrance is to allow for a safe transition from the P3 class lighting levels of the main road to the residential road's classification of P4 and to allow for sufficient light on the roadway for drivers to focus on the roads for safe driving within the vicinity of the residential houses/duplexes.

Zone Type (Based on development typology plans)	Allocated Class (Based on CEN/TR 13201-1:2015)
Zone 1 (Residential Roads)	P4
Zone 2 (Pedestrian Walkway)	P4
Zone 3 (Residential Entrance)	P3

***Figure 4 – Proposed Typology Lighting for the project***

### **LUMINAIRES**

For a list of luminaires used please refer to appendix B of this report.

The desired lighting design may also be achieved by other luminaires, and the final lighting installation may use other luminaires, with modified positioning and aiming to achieve the same result. Manufacturers stated performance characteristics are subject to change. Other changes may be agreed with DLRCC Road Lighting Department as the works progress on site.

### **LIGHT SPILL INTO RESIDENTIAL UNITS**

In the residential area fittings close to the residential units are to have appropriately low levels of light spill into the units. It was concluded that the levels were appropriately low. As an E3

zone a lux average level below 2 lux would be considered appropriate. Refer to Figure 6, results are shown that below 2 lux average has been achieved.

Table 2: Environmental zones


Zone	Surrounding	Lighting environment	Examples
E0	Protected	Dark (SQM 20.5+)	Astronomical Observable dark skies, UNESCO starlight reserves, IDA dark sky places
E1	Natural	Dark (SQM 20 to 20.5)	Relatively uninhabited rural areas, National Parks, Areas of Outstanding Natural Beauty, IDA buffer zones etc.
E2	Rural	Low district brightness (SQM ~15 to 20)	Sparingly inhabited rural areas, village or relatively dark outer suburban locations
E3	Suburban	Medium district brightness	Well inhabited rural and urban settlements, small town centres of suburban locations
E4	Urban	High district brightness	Town / City centres with high levels of night-time activity

**TABLE – CIE 150 Zone Categorization (2017)**

Table 3 (CIE 150 table 2); Maximum values of vertical illuminance on properties.

Light technical parameter	Application conditions	Environmental zone				
		E0	E1	E2	E3	E4
Illuminance in the vertical plane ( $E_v$ )	Pre-curfew	n/a	2 lx	5 lx	10 lx	25 lx
	Post curfew	n/a	<0.1 lx*	1 lx	2 lx	5 lx

**TABLE – CIE 150 Intrusive light (2017)**

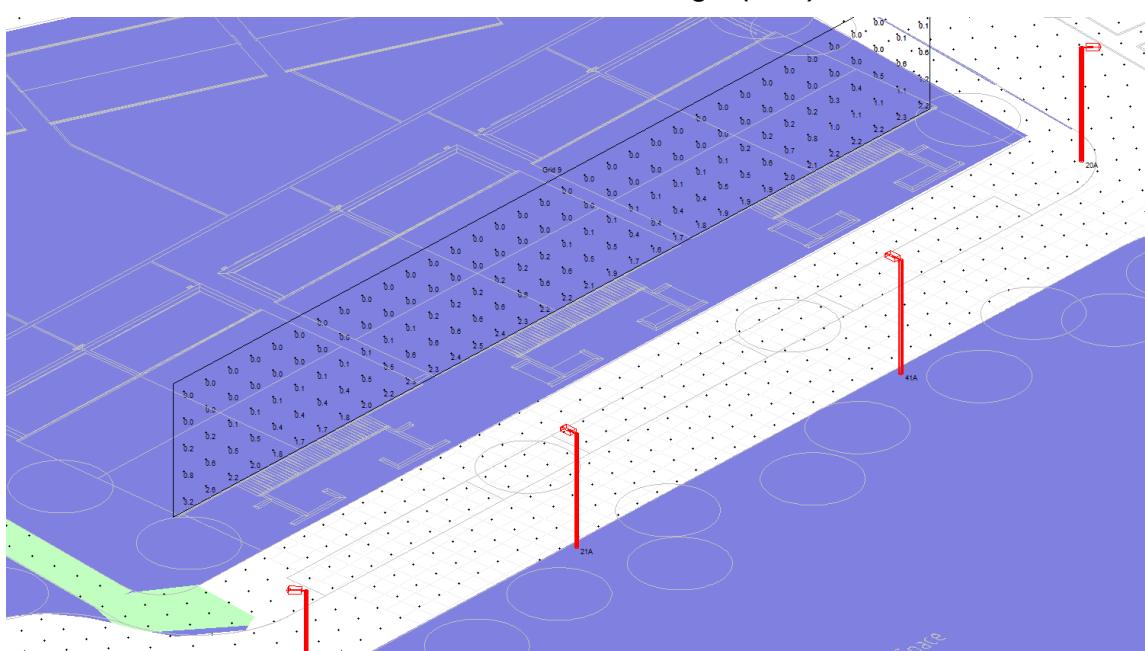

**Figure 5 – Example vertical grid for obtrusive lighting**

Eav	0.15
Emin	0.00
Emax	2.20

**Figure 6 – Results for the obtrusive lighting lux levels**

## 4 SUMMARY

As part of the development application, this external lighting strategy report outlines the preferred lighting options for the proposed site including the proposed secondary streets and shared surfaces, pedestrian and cycle links and public open spaces.

This document also described the control measures considered to ensure compliance with the following documents: -

- EN13201-2-2015 Lighting Classes for external lighting. (Published on: 31<sup>st</sup> Jan 2016 by BSI Standards Limited 2016)
- BS EN 12464-2 Outdoor workplaces (Published on: 31<sup>st</sup> Jan 2014 by BSI Standards Limited 2014)
- BS 5489-1-2020 Design of road lighting of roads and public amenity areas. Code of practice (Published on: 31<sup>st</sup> May 2020 by BSI Standards Limited 2020)
- BS EN 13201-2 Lighting Classes for external lighting. (Published on: 31<sup>st</sup> Jan 2016 by BSI Standards Limited 2016)
- CIBSE Lighting Guide 6 - The Outdoor environment (Published on: Jan 2016 by CIBSE publications)
- Institute of Lighting Professionals (ILP) Guidance notes for the reduction of obtrusive light. (Published on: Jan 2020 by Institution of Lighting Professionals publications)
- Dun Laoghaire-Rathdown County Council Public Lighting Specification

## 5 APPENDIX A – SITE DRAWING

DRAWING NOTES:

- DUCTING SHALL COMPLY WITH BSEN 5006-1,2-3-4 LATEST EDITION & SHALL BE LAYERED WITH A MINIMUM WALL THICKNESS OF 5mm. EACH LENGTH OF DUCT SHALL BE STAMPED WITH THE WORDS "PUBLIC LIGHTING", OR ALTERNATIVELY "STREET LIGHTING" OR "URBIS". DUCTS SHALL BE LAYERED IN A STRAIGHT LINE, IN COLUMN LOCATIONS & SHALL CONTAIN A CONTINUOUS DRAW WIRE OF BN STRENGTH.
- A MINIMUM DEPTH OF 450mm COVER IS REQUIRED IN URBAN PATHWAYS & A MINIMUM OF 600mm COVER IS REQUIRED FOR GRASS MARGINS, PEDESTRIAN WALKS, CYCLE PATHS & GATEWAYS. A MAXIMUM DEPTH OF 750mm IS REQUIRED IN ROAD CROSSINGS OR IN CAR PARKS/WAYS.
- ALL EQUIPMENT TO BE SUITABLY IP RATED FOR THE ENVIRONMENT THEY ARE BEING INSTALLED.
- FOR SCHEDULES OF EQUIPMENT SEE SPECIFICATION.
- THE COMPLETE INSTALLATION TO BE CO-ORDINATED WITH ALL OTHER SERVICES.

LEGEND OF SYMBOLS:

X1 = 6M COLUMN LIGHT C. U PHOSCO 16W E950-P4A  
 X2 = 6M COLUMN LIGHT C. U PHOSCO 5W E950-P3A  
 X3 = 6M COLUMN LIGHT C. U PHOSCO 16W E950-P2A  
 X4 = 6M COLUMN LIGHT C. U PHOSCO 18W E950-P4A  
 X5 = 4M COLUMN LIGHT URBIS SCHREDER FLEXIA TOP MINI 5393  
 PLMP = PUBLIC LIGHTING MINI PILLAR  
 PL = 110mm PUBLIC LIGHTING DUCT  
 LV = ESB 110mm LV DUCTING  
 MP = ESB MINI PILLAR



REFER TO LUMINAIRE SCHEDULE

REF: X2 LUMINAIRE  
 6M COLUMN LIGHT C. U PHOSCO 5W E950-P3A



REFER TO LUMINAIRE SCHEDULE

REF: X3 LUMINAIRE  
 6M COLUMN LIGHT C. U PHOSCO 16W E950-P2A




REFER TO LUMINAIRE SCHEDULE

REF: X4 LUMINAIRE  
 6M COLUMN LIGHT C. U PHOSCO 18W E950-P4A




REFER TO LUMINAIRE SCHEDULE

REF: X5 LUMINAIRE  
 4M COLUMN LIGHT URBIS SCHREDER FLEXIA TOP MINI 5393



REFER TO LUMINAIRE SCHEDULE

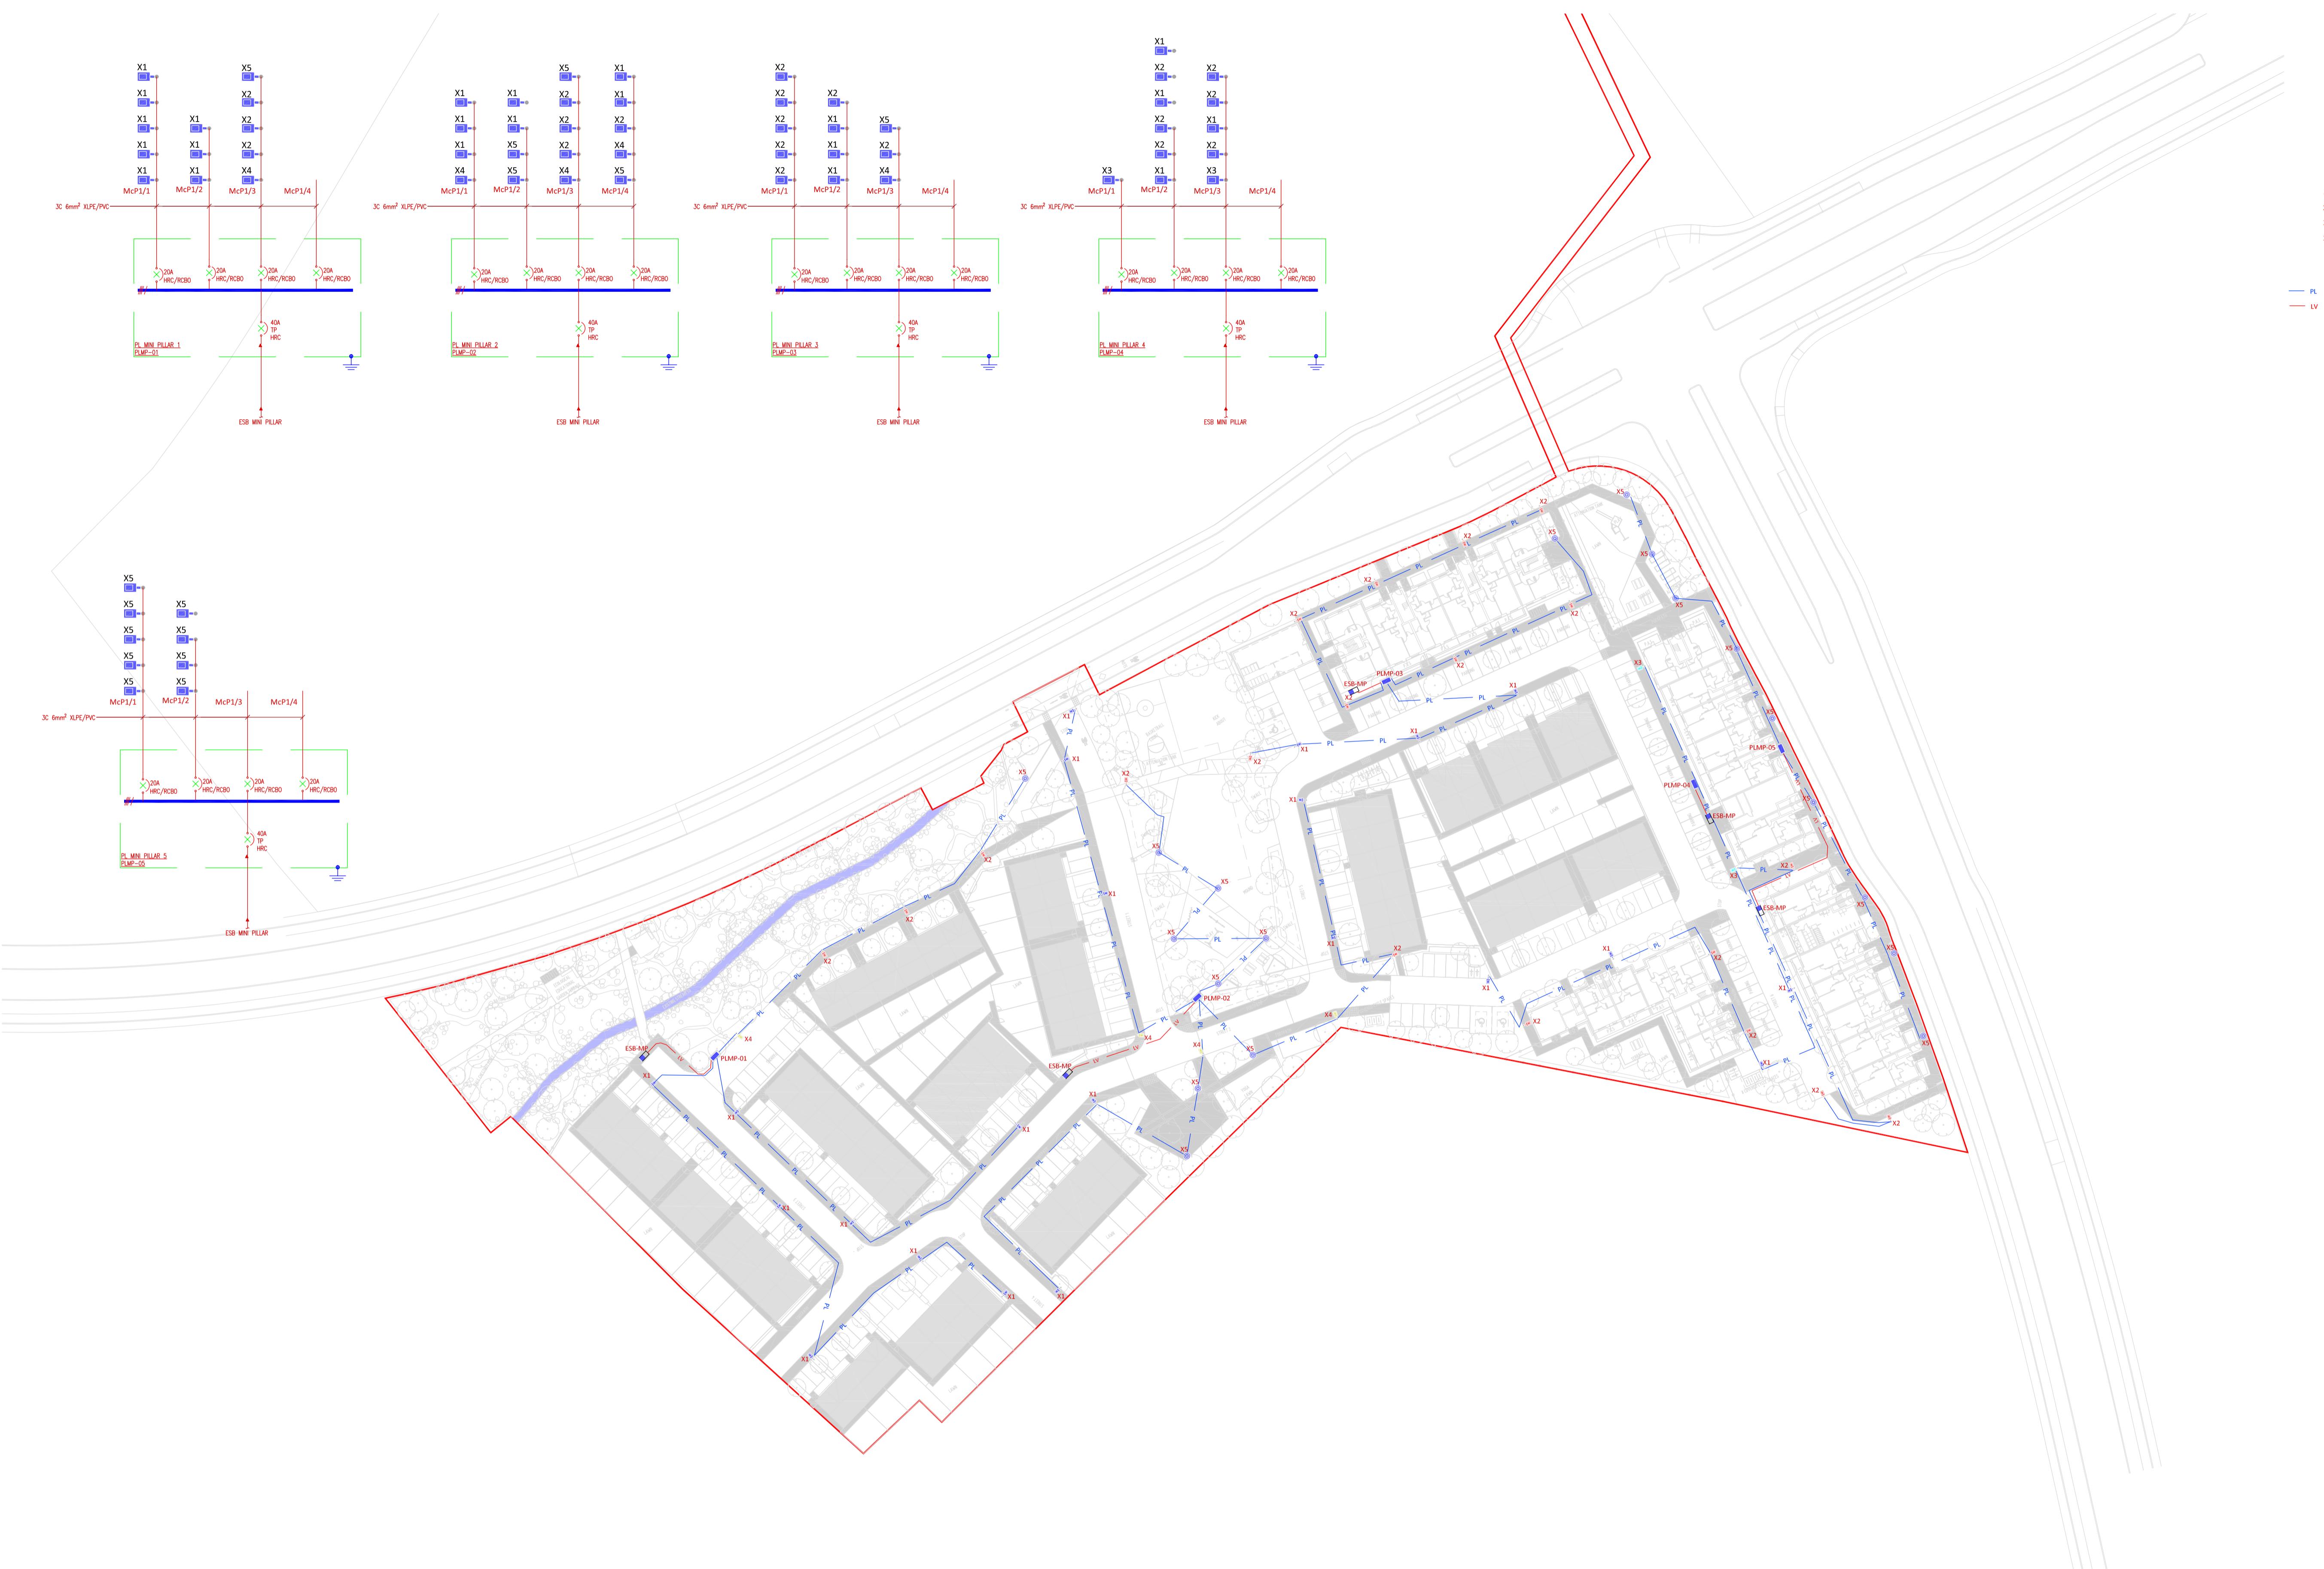

THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER  
 RELEVANT DESIGN TEAM DRAWINGS AND SPECIFICATIONS.  
 FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS.  
 DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY.  
 NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED  
 IN WHOLE OR IN PART, IN ANY FORM, BY ELECTRONIC MEANS  
 WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CRONIN  
 AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT  
 FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

Rev No.	Date	Revision Note	Drawn by	Checked by
P01	11.12.25	ISSUED FOR PLANNING.	J.B.	S.B.
P02	12.12.25	ISSUED FOR PLANNING	J.B.	B.F.

Rev No.	Date	Revision Note	Drawn by	Checked by



Client: Durkan Glenamuck Developments Limited  
 Project: KILTERNAN SOUTH  
 Title: ELECTRICAL SITE LIGHTING LAYOUT  
 Code: 1 Originator 1 Zone 1 Level 1 Type 1 Pole 1 Number: S4 Revision: P02  
 Dublin • London • Belfast • Galway • Cork • Birmingham  
 Date: 10.12.25 Scale @ 1:500 Drawing J.B. Checked S.B. Approved by: B.F.

## 6 APPENDIX B – SITE CALCULATION REPORT WITH LUMINAIRE DATASHEETS-

**DATE:** 10 December 2025  
**DESIGNER:** Samaneh Baranbooei  
**PROJECT No:** E451  
**PROJECT NAME:** Kilternan South

**LIGHTING  
REALITY**

## **Outdoor Lighting Report**

## Layout Report

### General Data

Dimensions in Metres Angles in Degrees

### Calculation Grids

ID	Grid Name	X	Y	X' Length	Y' Length	X' Spacing	Y' Spacing
1	Grid 1	720550.19	722962.52	344.53	326.65	1.50	1.52
2	Entrance 1	720696.18	723118.95	9.10	10.03	0.54	0.59
3	Entrance 2	720692.03	722994.57	10.07	9.80	0.40	0.39
4	intrusive light	720599.92	723046.38	60.61	5.00	1.48	1.25
5	Intrusive light Grid 5	720808.90	723156.12	52.81	5.00	2.11	0.20

### Luminaires



#### Luminaire A Data

Supplier	C U Phosco
Type	E950-28-P4A-727-C650-16W
Lamp(s)	727N
Lamp Flux (klm)	2.35
File Name	E950-28-P4A-727-C0650-16W.ies
Maintenance Factor	0.85
Imax70,80,90(cd/klm)	659.3, 183.1, 0.3
No. in Project	22



#### Luminaire B Data

Supplier	C U Phosco
Type	E950-28-R3A-727-C200-5W
Lamp(s)	727N
Lamp Flux (klm)	0.77
File Name	E950-28-R3A-727-C0200-5W.ies
Maintenance Factor	0.85
Imax70,80,90(cd/klm)	716.7, 30.5, 0.3
No. in Project	19



#### Luminaire C Data

Supplier	C U Phosco
Type	E950-28-F2A-727-C650-16W
Lamp(s)	727N
Lamp Flux (klm)	2.39
File Name	E950-28-F2A-727-C0650-16W.ies
Maintenance Factor	0.85
Imax70,80,90(cd/klm)	623.6, 113.9, 0.3
No. in Project	3



#### Luminaire D Data

Supplier	C U Phosco
Type	E950-28-P4A-727-SA0400-18W
Lamp(s)	727SA
Lamp Flux (klm)	2.00
File Name	E950-28-P4A-727-SA0400-18W.ies
Maintenance Factor	0.85
Imax70,80,90(cd/klm)	551.4, 55.4, 4.1
No. in Project	4



#### Luminaire F Data

Supplier	Urbis Schreder
Type	FLEXIA TOP MINI 5393 [Deep shape PC], I Lum. shape-related, PI 10 LH351C@200mA WW 730 230V 00-53-394
Lamp(s)	10 LH351C@200mA WW 730 230V 00-53-394
LampFlux(klm)/Colour	1.12 WW 3000K/70
File Name	FLEXIA TOP MINI 5393 10 LH351C 200mA WW 730 7.8W 557922 PC 230V EF.ldt
Maintenance Factor	0.85
Imax70,80,90(cd/klm)	437.7, 77.6, 25.5
No. in Project	19

Layout


ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
1	A	720643.20	722988.09	6.00	132.00	0.00	0.00	1.00			
2	A	720667.41	723009.56	6.00	132.00	0.00	0.00	0.50			
3	A	720652.38	723018.31	6.00	224.00	0.00	0.00	0.50			
4	A	720635.33	723020.83	6.00	49.00	0.00	0.00	0.50			
5	A	720607.72	723047.19	6.00	49.00	0.00	0.00	0.50			
6	A	720687.30	723039.40	6.00	328.00	0.00	0.00	0.50			
7	A	720685.16	723001.04	6.00	42.00	0.00	0.00	0.50			
8	D	720626.92	723058.77	6.00	322.00	0.00	0.00	0.50			
9	D	720729.09	723053.99	6.00	121.00	0.00	0.00	0.50			
10	D	720713.33	723058.13	6.00	355.00	0.00	0.00	0.60			
11	A	720707.65	723082.41	6.00	12.00	0.00	0.00	0.60			
12	A	720697.76	723117.40	6.00	16.00	0.00	0.00	0.60			
13	D	720757.55	723062.09	6.00	107.00	0.00	0.00	0.50			
14	A	720757.60	723079.98	6.00	197.00	0.00	0.00	0.50			
15	A	720750.67	723109.33	6.00	175.00	0.00	0.00	0.50			
16	A	720772.30	723120.60	6.00	122.00	0.00	0.00	0.50			
17	A	720797.49	723132.04	6.00	128.00	0.00	0.00	0.50			
18	B	720759.29	723131.21	6.00	297.00	0.00	0.00	0.50			
19	B	720783.13	723141.51	6.00	297.00	0.00	0.00	0.50			
20	B	720808.35	723153.38	6.00	292.00	0.00	0.00	0.50			
21	C	720824.78	723138.38	6.00	214.00	0.00	0.00	0.50			
22	C	720834.42	723116.35	6.00	213.00	0.00	0.00	0.50			
23	C	720844.63	723094.36	6.00	209.00	0.00	0.00	0.50			
24	B	720858.28	723094.62	6.00	111.00	0.00	0.00	0.50			
25	A	720856.98	723068.01	6.00	211.00	0.00	0.00	0.50			
26	B	720838.75	723075.30	6.00	27.00	0.00	0.00	0.50			
27	A	720850.35	723051.28	6.00	117.00	0.00	0.00	0.50			
28	B	720877.82	723040.77	6.00	108.00	0.00	0.00	0.50			
29	A	720817.49	723075.11	6.00	111.00	0.00	0.00	0.50			
30	A	720791.18	723071.09	6.00	264.00	0.00	0.00	0.50			
31	A	720748.86	723120.74	6.00	33.00	0.00	0.00	0.50			
32	A	720627.58	723041.74	6.00	221.00	0.00	0.00	0.50			
33	B	720864.47	723045.36	6.00	73.00	0.00	0.00	0.50			
34	A	720697.98	723003.07	6.00	230.00	0.00	0.00	0.50			
35	A	720705.00	723043.52	6.00	108.00	0.00	0.00	0.50			
36	F	720725.49	723031.71	4.00	88.00	0.00	0.00	0.50			

Layout Continued

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
37	F	720739.44	723053.97	4.00	328.00	0.00	0.00	0.50			
38	F	720726.67	723046.14	4.00	313.00	0.00	0.00	0.50			
39	B	720645.54	723077.38	6.00	298.00	0.00	0.00	0.50			
40	B	720663.34	723086.70	4.00	303.00	0.00	0.00	0.50			
41	B	720679.88	723098.96	6.00	311.00	0.00	0.00	0.50			
42	B	720712.43	723111.46	6.00	98.00	0.00	0.00	0.50			
43	F	720690.22	723113.88	4.00	325.00	0.00	0.00	0.50			
44	B	720739.36	723119.35	6.00	263.00	0.00	0.00	0.50			
45	F	720721.09	723104.84	4.00	171.00	0.00	0.00	0.50			
46	F	720725.63	723093.96	4.00	235.00	0.00	0.00	0.50			
47	F	720743.43	723079.74	4.00	223.00	0.00	0.00	0.50			
48	F	720722.95	723078.01	4.00	107.00	0.00	0.00	0.50			
49	F	720732.32	723069.33	4.00	95.00	0.00	0.00	0.50			
50	B	720748.81	723147.89	6.00	17.00	0.00	0.00	0.50			
51	B	720765.90	723158.11	6.00	295.00	0.00	0.00	0.50			
52	B	720785.05	723166.79	6.00	295.00	0.00	0.00	0.50			
53	B	720801.85	723174.08	6.00	293.00	0.00	0.00	0.50			
54	F	720804.96	723166.85	4.00	309.00	0.00	0.00	0.50			
55	F	720820.54	723175.74	4.00	246.00	0.00	0.00	0.50			
56	F	720824.98	723161.15	6.50	193.00	0.00	0.00	0.50			
57	F	720831.06	723153.22	4.00	300.00	0.00	0.00	0.50			
58	F	720845.91	723142.50	4.00	212.00	0.00	0.00	0.50			
59	F	720853.74	723127.33	4.00	207.00	0.00	0.00	0.50			
60	F	720862.59	723109.01	4.00	208.00	0.00	0.00	0.50			
61	F	720873.55	723088.20	4.00	208.00	0.00	0.00	0.50			
62	F	720879.06	723075.76	4.00	208.00	0.00	0.00	0.50			
63	F	720885.78	723057.81	4.00	214.00	0.00	0.00	0.50			
68	B	720797.84	723059.72	6.00	20.00	0.00	0.00	0.50			
69	B	720846.40	723058.39	6.00	25.00	0.00	0.00	0.50			
70	A	720701.25	723129.07	6.00	210.00	0.00	0.00	0.50			
71	B	720769.76	723075.22	6.00	30.00	0.00	0.00	0.50			

## Horizontal Illuminance (lux)

Grid 1

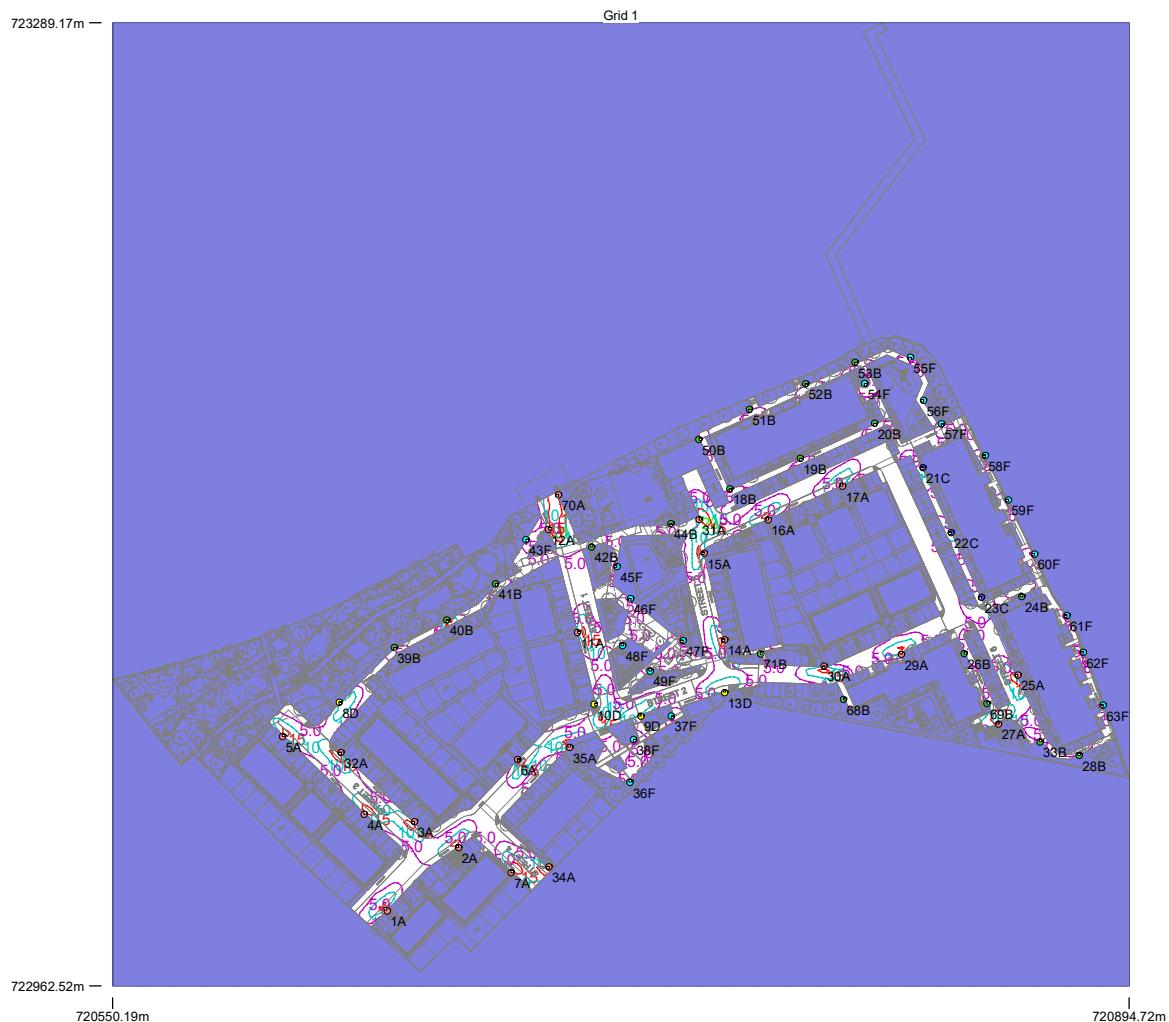


## Results

Eav	6.05
Emin	1.17
Emax	20.70
Emin/Emax	0.06
Emin/Eav	0.19

## Horizontal Illuminance (lux)


Entrance 1

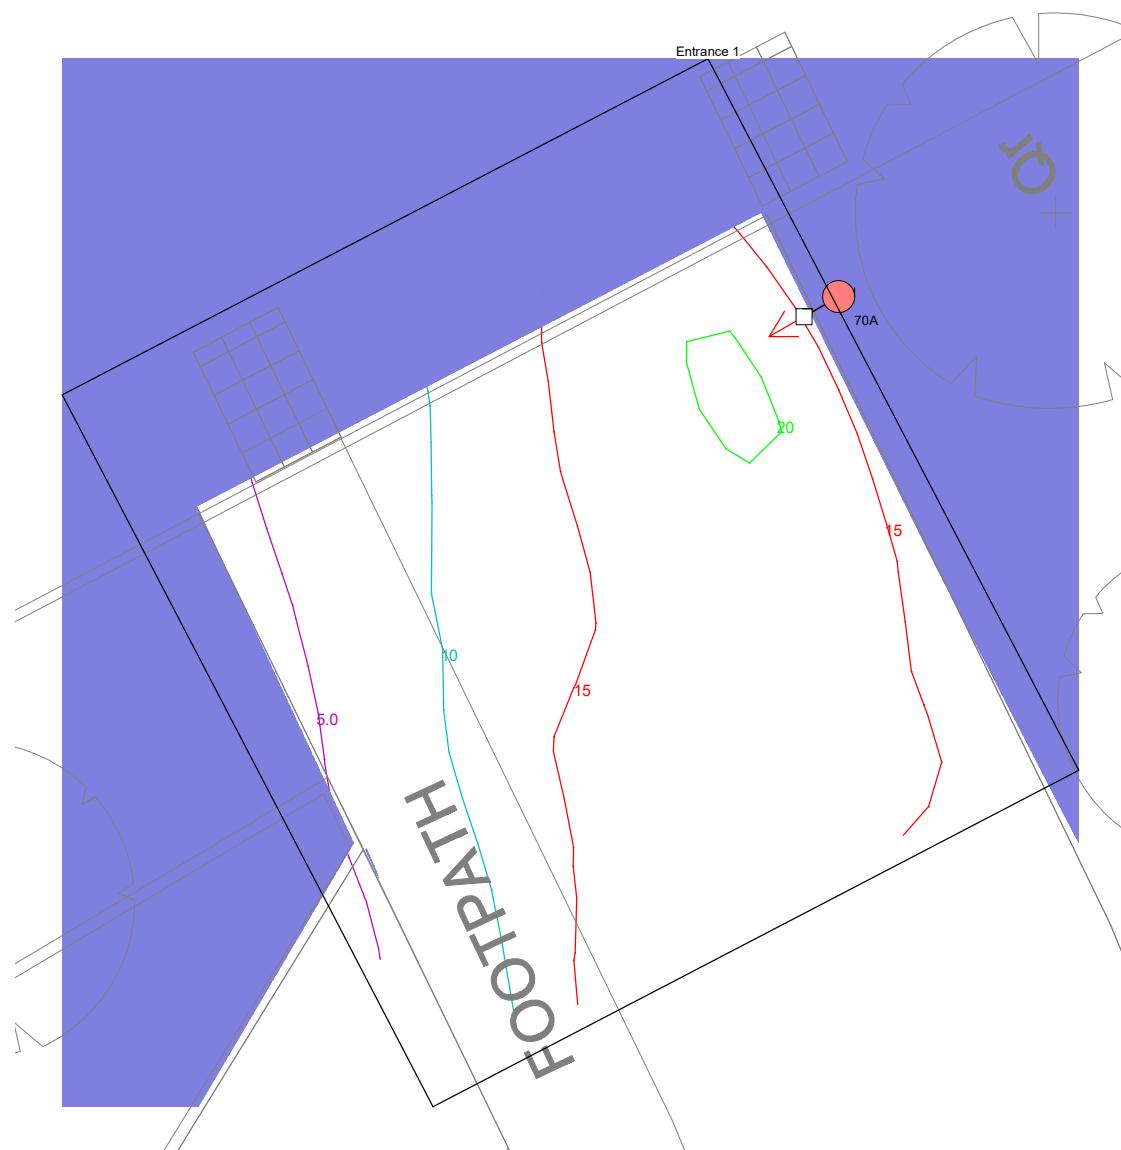

### Results

Eav	13.70
Emin	4.01
Emax	20.50
Emin/Emax	0.20
Emin/Eav	0.29

## Horizontal Illuminance (lux)

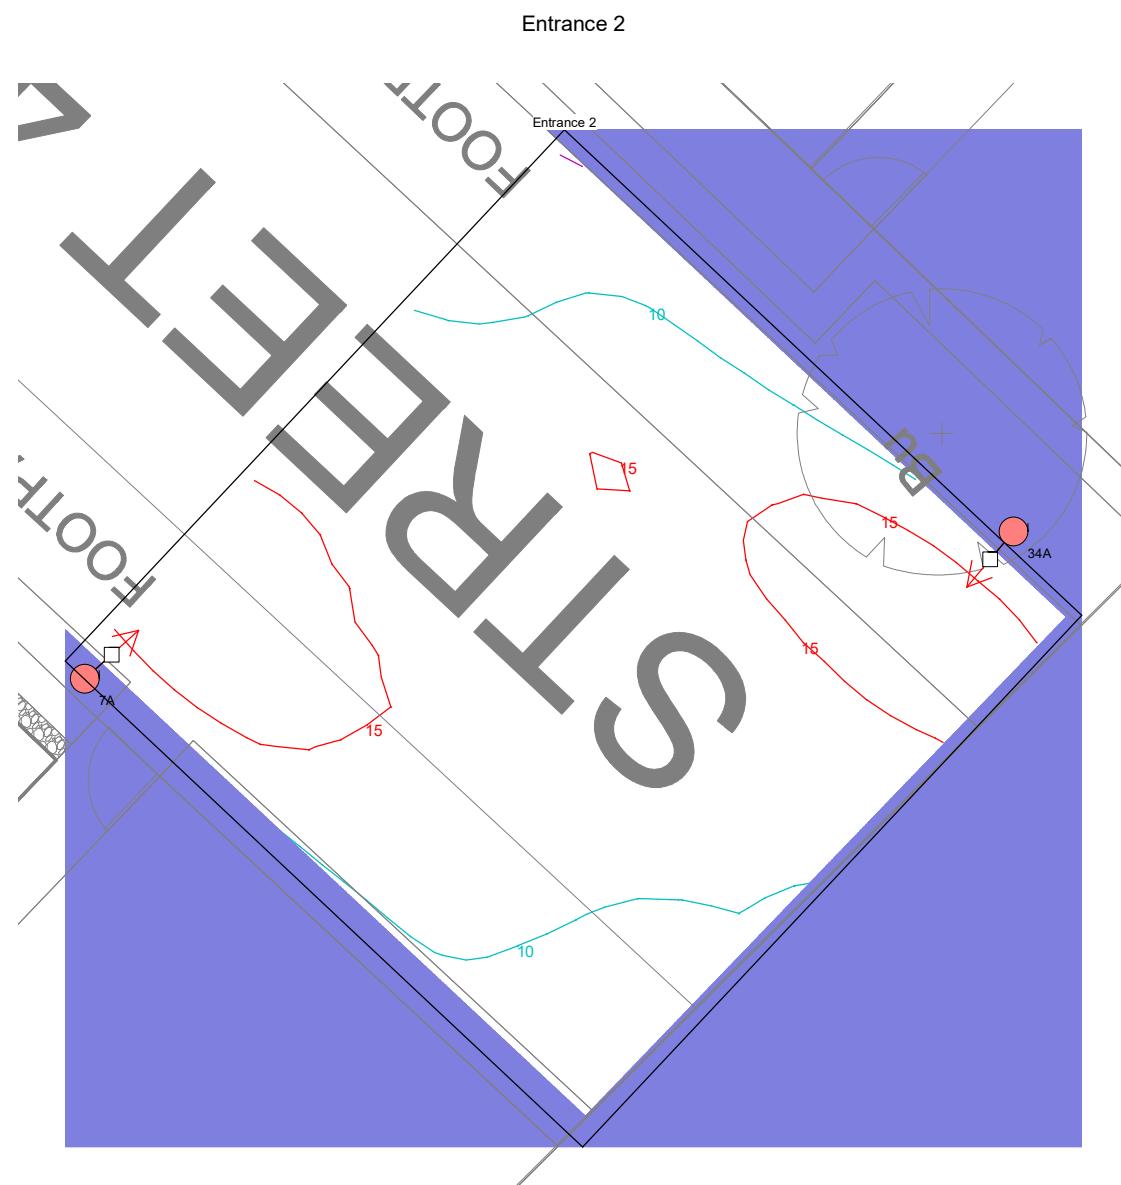

### Results

Eav	12.70
Emin	4.79
Emax	18.79
Emin/Emax	0.25
Emin/Eav	0.38

## Illuminance (lux)

intrusive light



### Results

Eav	0.02
Emin	0.00
Emax	0.41
Emin/Emax	0.00
Emin/Eav	0.00

## Illuminance (lux)

Intrusive light Grid 5



### Results

Eav	0.11
Emin	0.01
Emax	2.02
Emin/Emax	0.00
Emin/Eav	0.08



O'CONNOR · SUTTON · CRONIN  
MULTIDISCIPLINARY CONSULTING ENGINEERS

---

**Head Office**

9 Prussia Street

Dublin 7

Ireland

D07KT57

T: +353 (0)1 8682000

E: [ocsc@ocsc.ie](mailto:ocsc@ocsc.ie) | W: [www.ocsc.ie](http://www.ocsc.ie)