



## NOTES:

1. Read in conjunction with all relevant Architect's & Engineer's drawings and cross read the detailed notes on the various manholes.
2. The minimum diameter of manholes as shown in Table A, this may need be increased subject to the number of branches, this is made up as follows:  
For pipes up to 150mm<sup>2</sup>, provide the sum of the branches + 200mm per branch + 300mm  
For pipes over 150mm<sup>2</sup>, provide the sum of the branches + 300mm per branch + 300mm  
= 1525mm (subject to minimum length)
3. Access steps shall be provided in manholes greater than 1m to the invert level of the pipe.
4. A 200mm concrete surround, 100mm deep, shall be provided around manhole covers in grassed areas.
5. Class U2 finish to the top of slabs. Reinforcement in the slabs to details as directed by the Engineer.
6. Manhole foundations to be 225mm C30/37 mass concrete with 75mm lean mix concrete.
7. Use precast half turn channel pipes through manholes but the pipeline may be laid through the manhole and the crown cut out to half diameter ensuring that flexible joints are located either side of manhole at max.600mm as measured from the inner face of manhole wall.
8. Use CL 20/10 concrete for benching and pipe channel surround.
9. Benching to be finished in 1:3 cement-sand mortar with a smooth trowel finish, 1 in 30 slope towards channel. Form a 25mm radius nosing on benching, level with crown of the pipe.
10. Standard drainaged (BS 729) runs to be positioned @ 300c/c vertically.
11. Manholes to have a min. 600mm square ope.
12. 225mm Precast R.C. Roof Slab in C30/37 Concrete. Cover to steel shall be 40mm.
13. MH cover frame to be laid on 1 No. min to 3 No. max. courses of engineering bricks CL 18.
14. MH cover and frames to be Class D400 to IS/EN 124, 150mm deep frame for roads, 100mm deep for footpaths and green areas. Class B250 manhole covers may be used in private areas accessible to light vehicular traffic. Non-rock design, closed keyways, manufactured from spheroidal graphite cast iron (ductile cast iron), 600mm min. (600x600x100) mm<sup>3</sup> cover to steel shall be 40mm. Other approved materials, cover to have a maximum mass of 140kg/m<sup>2</sup>, frame bearing area shall be 80.000mm<sup>2</sup> min., frames shall be designed to prevent covers falling into manhole. Frames shall be bedded on C50/60 mortar to manufacturers instructions.
15. Galvanised steel safety railings to be provided in benching of sewers greater than 450mm Ø and depth to invert-3m for access to invert. Toe holes of 230mm min. depth to be provided where channel >600mm.
16. Safety chain to be provided on pipes that exceed 450mm Ø. Stainless steel safety chain shall be of same size graded M(H) non calibrated chart type 1.
17. When depth of Manholes to invert is greater than 3.0m, ladders shall be used, instead of rungs 25mm in diam. B.S.4211 except that strings should not be less than 65x20mm, in section and rungs 25mm in diam. Fixed ladders should meet the dimensional requirements of B.S.4211.
18. Ladder strings should be adequately supported from the Manhole wall at intervals of not more than 2.0m. Strings should be bolted to cleats to allow renewal.
19. Socket of pipe to be cut flush with the inner surface of the manhole wall.
20. Where there are changes in deep manholes, provide a 90mm square ope in the intermediate roof slab.
21. All Manholes shall be watertight to the satisfaction of the Engineer. Formwork to reinforced concrete and mass concrete shall comply to Class 2, Section 4.2.7 BS8110:Part 1:1997. Finish to the top of slabs shall comply to Type A, Section 6.2.7 BS8110: Part 1: 1997. Manholes are designed to B.S.8005 and wall thicknesses to I.S.3235.
22. Precast Manholes, Chamber walls and cover slab to be constructed to IS EN 1917 and I.S.420/2000.
23. All manholes to be situated furthest from the nearest carriageway. Manhole steps/ access to be positioned to allow viewing of oncoming traffic.
24. For bedding and sealing of chamber rings, the top ring below PC slab and bottom ring to be bedded with cement mortar. For intermediate rings, joints to be sealed with approved pre-formed jointing strip.
25. Pre cast Manholes to be surrounded with a minimum of 150mm thick Grade C25/30 concrete.

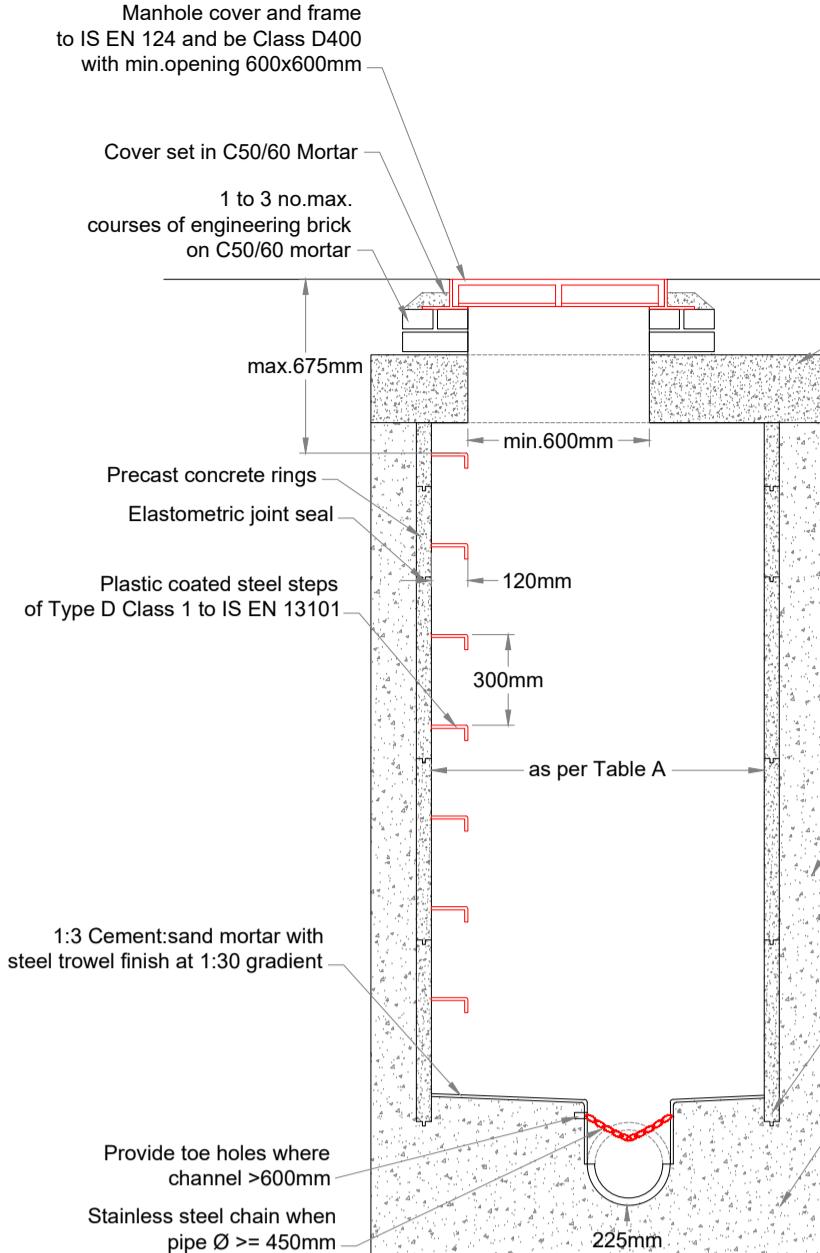

Section A-A  
Type A <3m depth

Scale 1:20

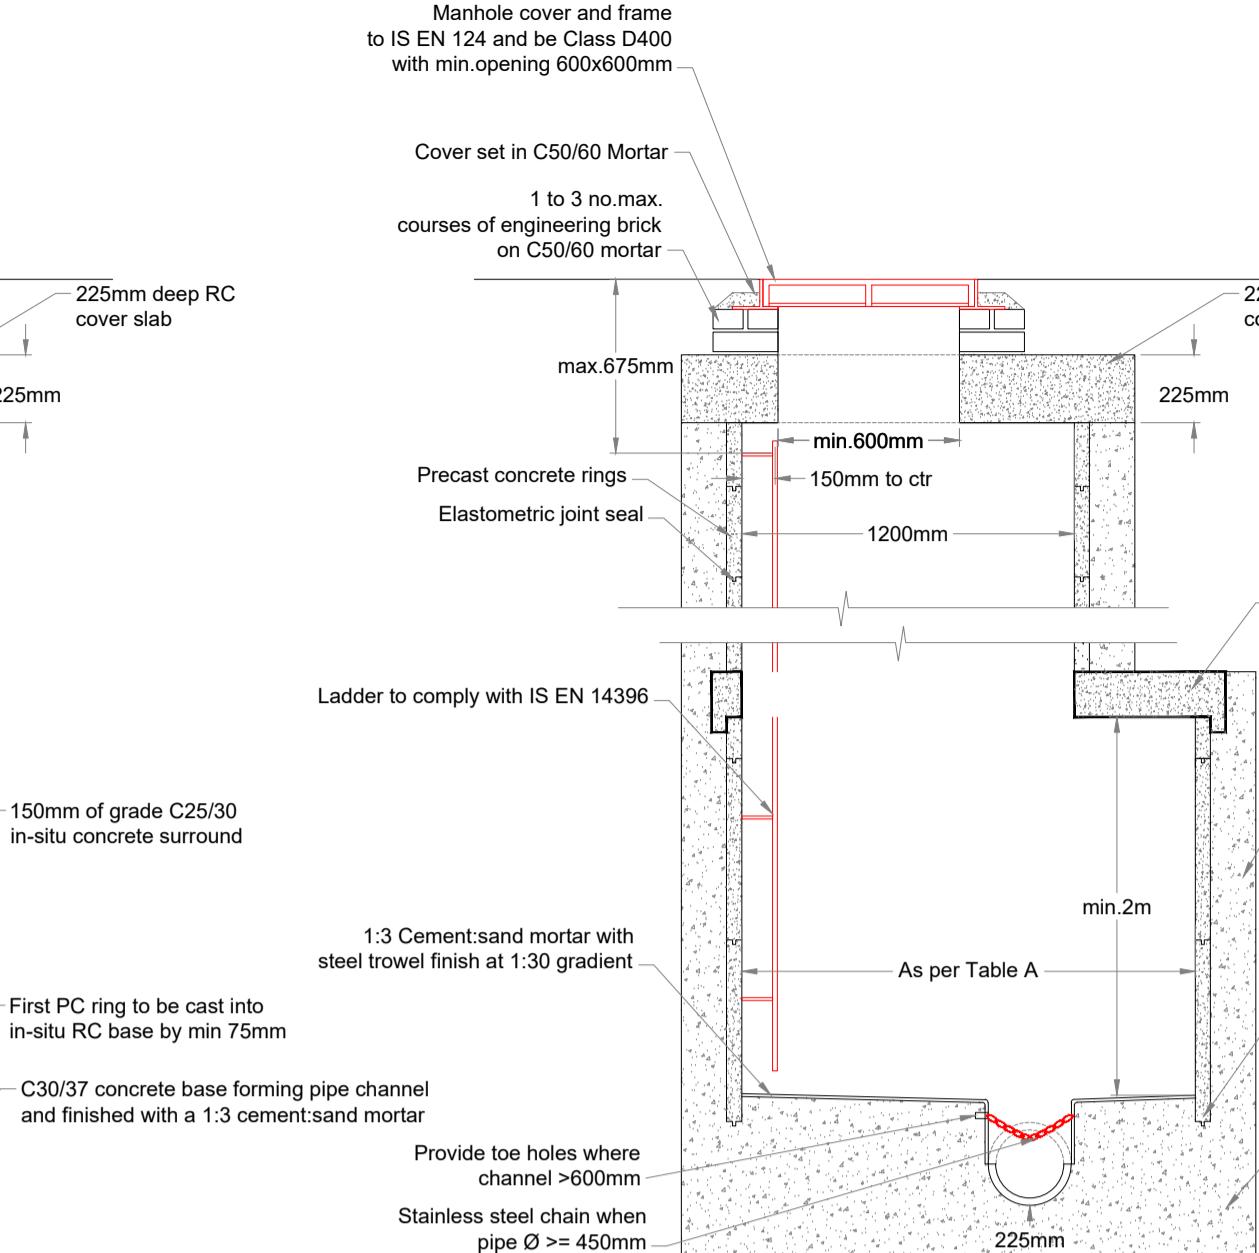


Section A-A  
Type B 3-6m depth

Scale 1:20

TABLE A


DEPTH (m)	TYPE	PIPE DIAMETER (mm)				
		150	225	300	375	450
0-1	PRECAST	A 1050Ø	A 1200Ø	A 1200Ø	A 1200Ø	A 1200Ø
1-3	PRECAST	A 1050Ø	A 1200Ø	A 1200Ø	A 1350Ø	A 1350Ø
3-6	PRECAST	B 1200Ø	B 1200Ø	B 1200Ø	B 1350Ø	B 1500Ø

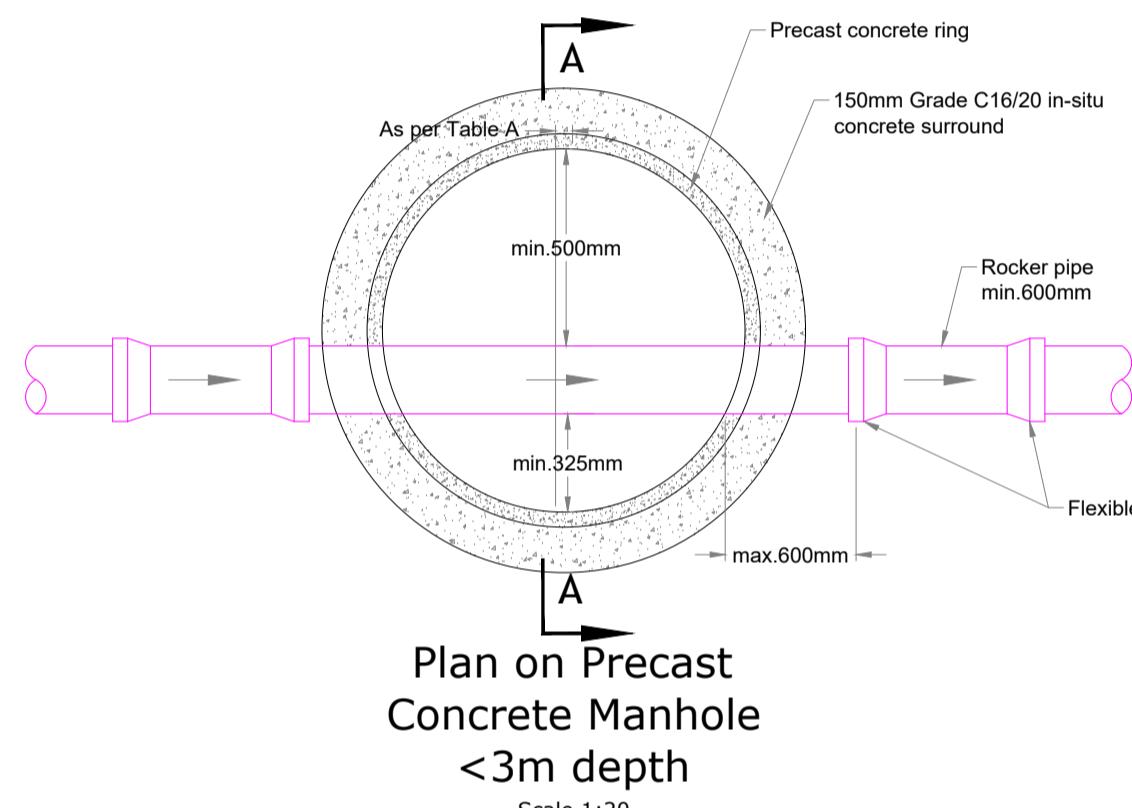

Plan on Precast  
Concrete Manhole  
<3m depth

Scale 1:20


## TYPICAL MANHOLE DETAIL

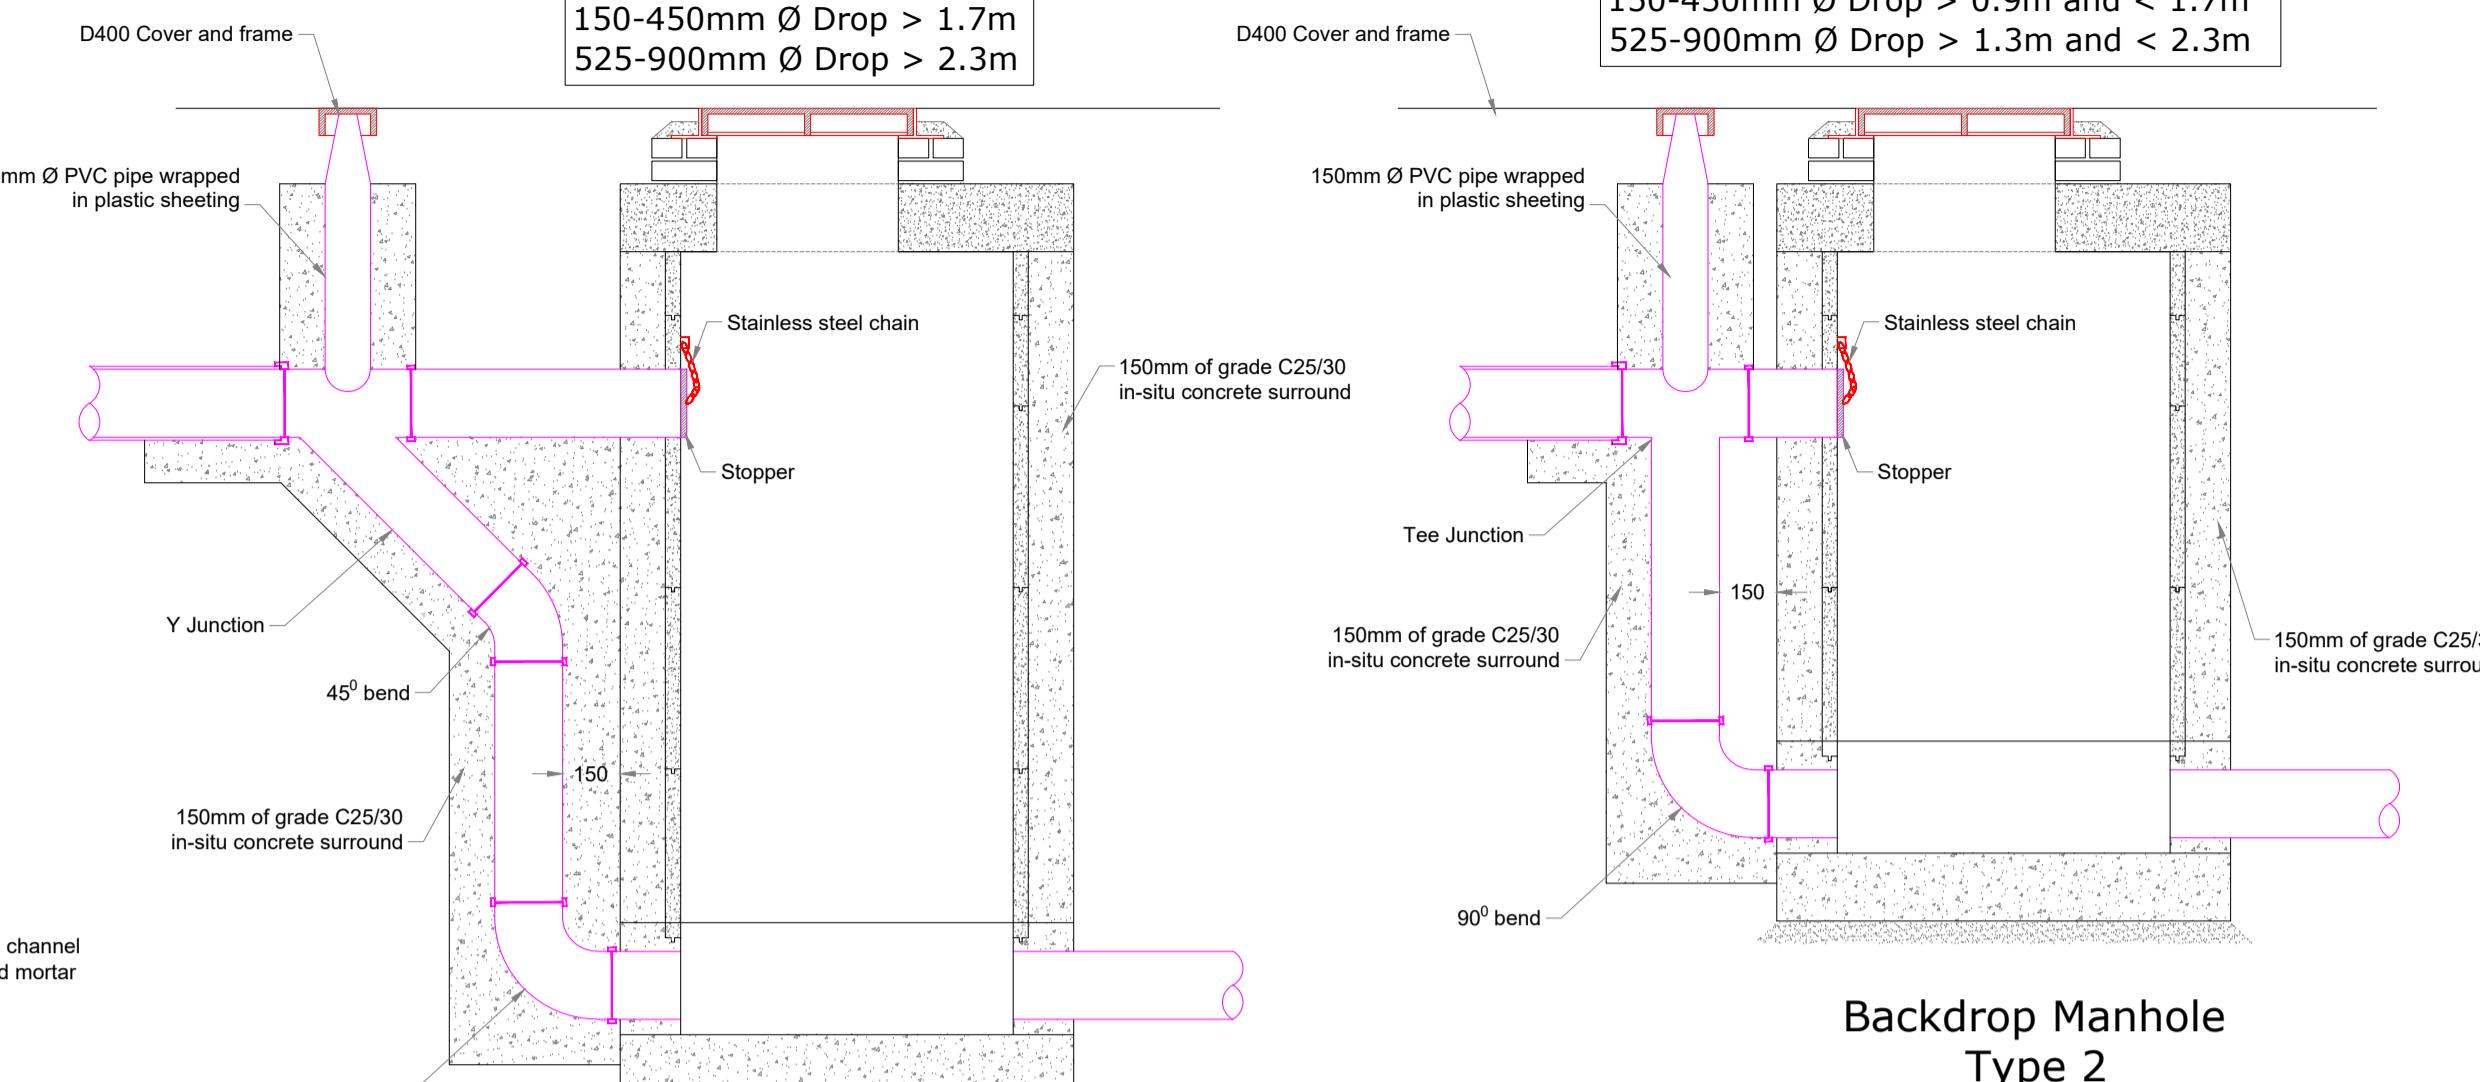

Backdrop Manhole  
Type 1


Scale 1:20

150-450mm Ø Drop > 0.6m and < 0.9m  
525-900mm Ø Drop > 0.6m and < 1.3m

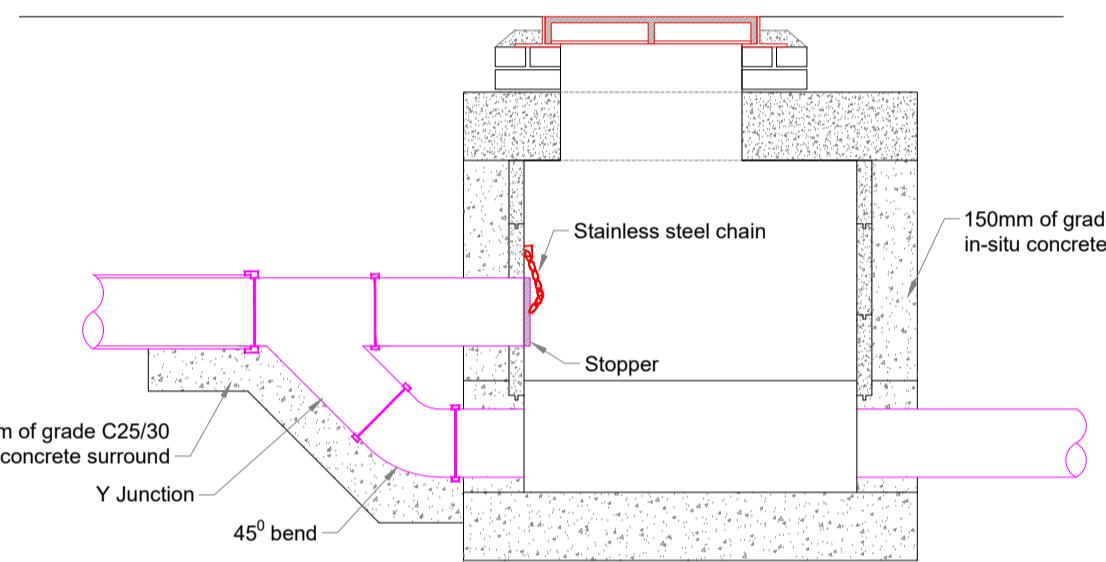

Backdrop Manhole  
Type 2

Scale 1:20

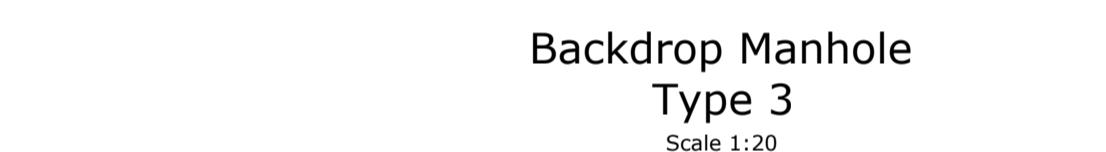

Backdrop Manhole  
Type 3

Scale 1:20

## PIPE BEDDING & BACK FILLING NOTES:-

1. Pipe backfill to be granular material to C804/808 in accordance with the NRA Specification for Road Works. Use only L808 material when within 500mm of cement bound materials such as concrete kerbs/paths/haunching.
2. Backfill material to be well compacted in accordance with CL 802 of the NRA specification.
3. Backfill in open trenches shall consist of suitable selected excavated material, shall be free from stones greater than 25mm in size, builders rubbish, vegetable matter and lumps of clay greater than 75mm in size and shall be compacted in 150mm layers. It shall meet the requirements of 'Acceptable material' as defined in Clause 601 of the NRA Specification for Road Works.
4. Pipe bedding shall be in accordance with WIS 4-08-02 and IGN 4-08-01. Granular material to be 50mm thick granular bedding and backfill to be compacted to 1324.
5. All pipes to have a 150mm concrete surround where the cover is less than 900mm in trafficked areas. All other pipework to be to bedding details as shown.
6. Concrete for pipe bedding, haunching and surrounds shall be C16/20 and have expansion joints at all pipe joints using 18mm filler board.
7. Formwork for Reinforced Concrete and mass concrete shall be class F2.
8. Wrap PE pipes in plastic sheeting before casting into concrete.

All pipe/manhole details to be compliant with  
Uisce Éireann Wastewater Infrastructure Standard  
Details document '25'


THIS IS A PLANNING DRAWING AND IS  
FOR THE APPROVAL OF UISCE ÉIREANN



Precast Concrete  
Gully Pit

SCALE 1:50


N.B.  
All gullies to be positioned at low points  
and no ponding of S/W is acceptable.  
Adjustment to suit site conditions to be  
discussed with RMA where variation to  
drawings occurs

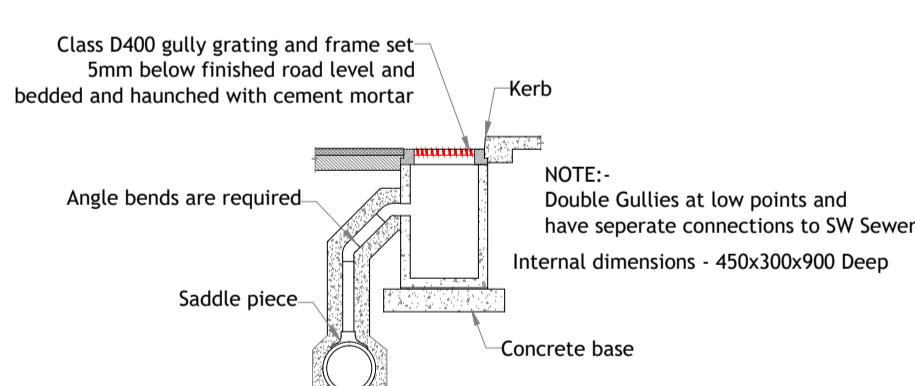

Gully Connection

SCALE 1:50

## CONCRETE BED/HAUNCH/SURROUND DETAILS

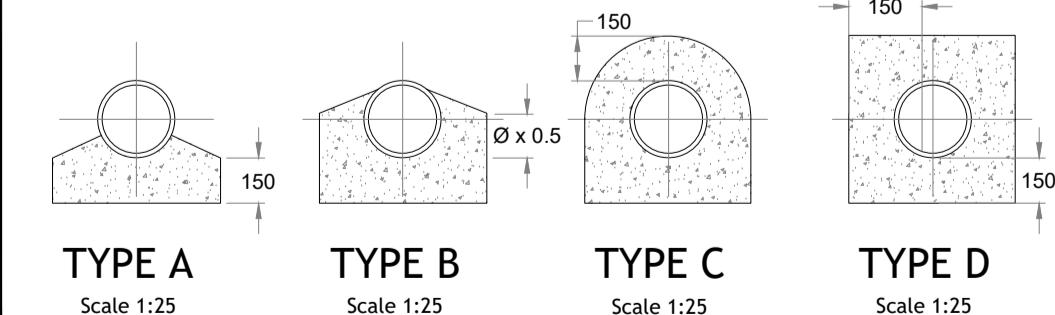

TYPE A

Scale 1:25

TYPE B

Scale 1:25


TYPE C

Scale 1:25

TYPE D


Scale 1:25

Pipe Diameter "A" (mm) <80 Rising Main	Trench Width "B" (mm) <500 TBC with Eng.
100	500
150	600
200	600
250	750
300	750
350	750
400	900
450	900

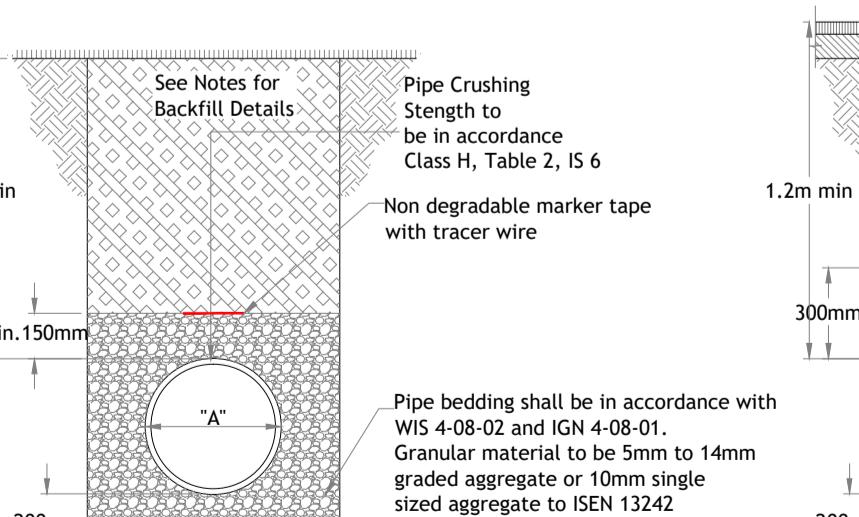


CROSS SECTION  
GRASSED AREA  
Granular Bed & Surround

Scale 1:25

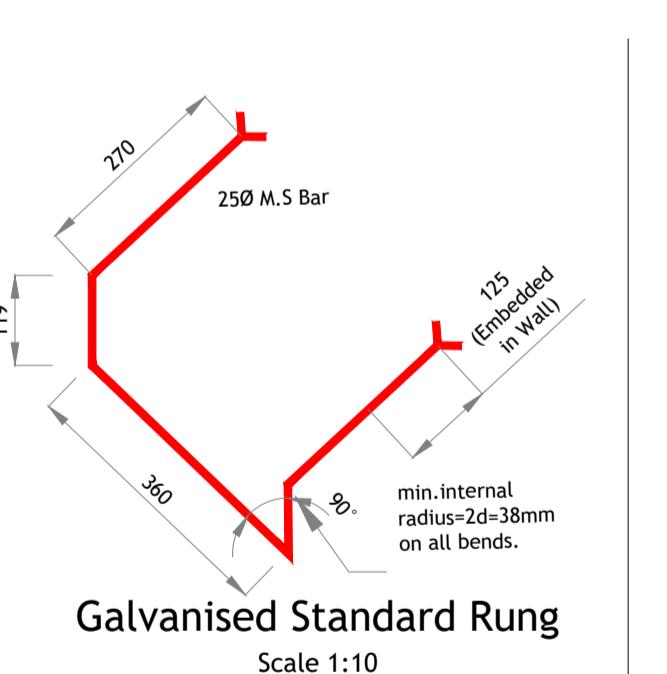


Galvanised Standard Rung

Scale 1:10

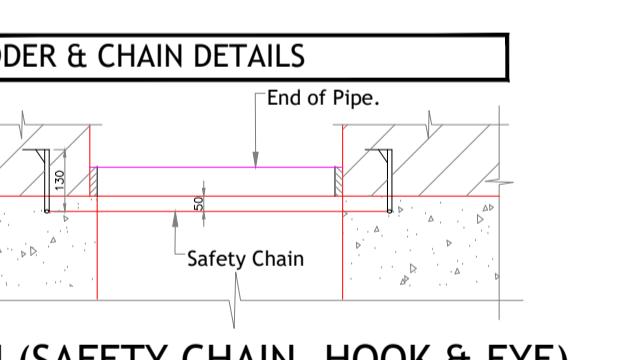

PLAN (SAFETY CHAIN, HOOK & EYE)

NTS

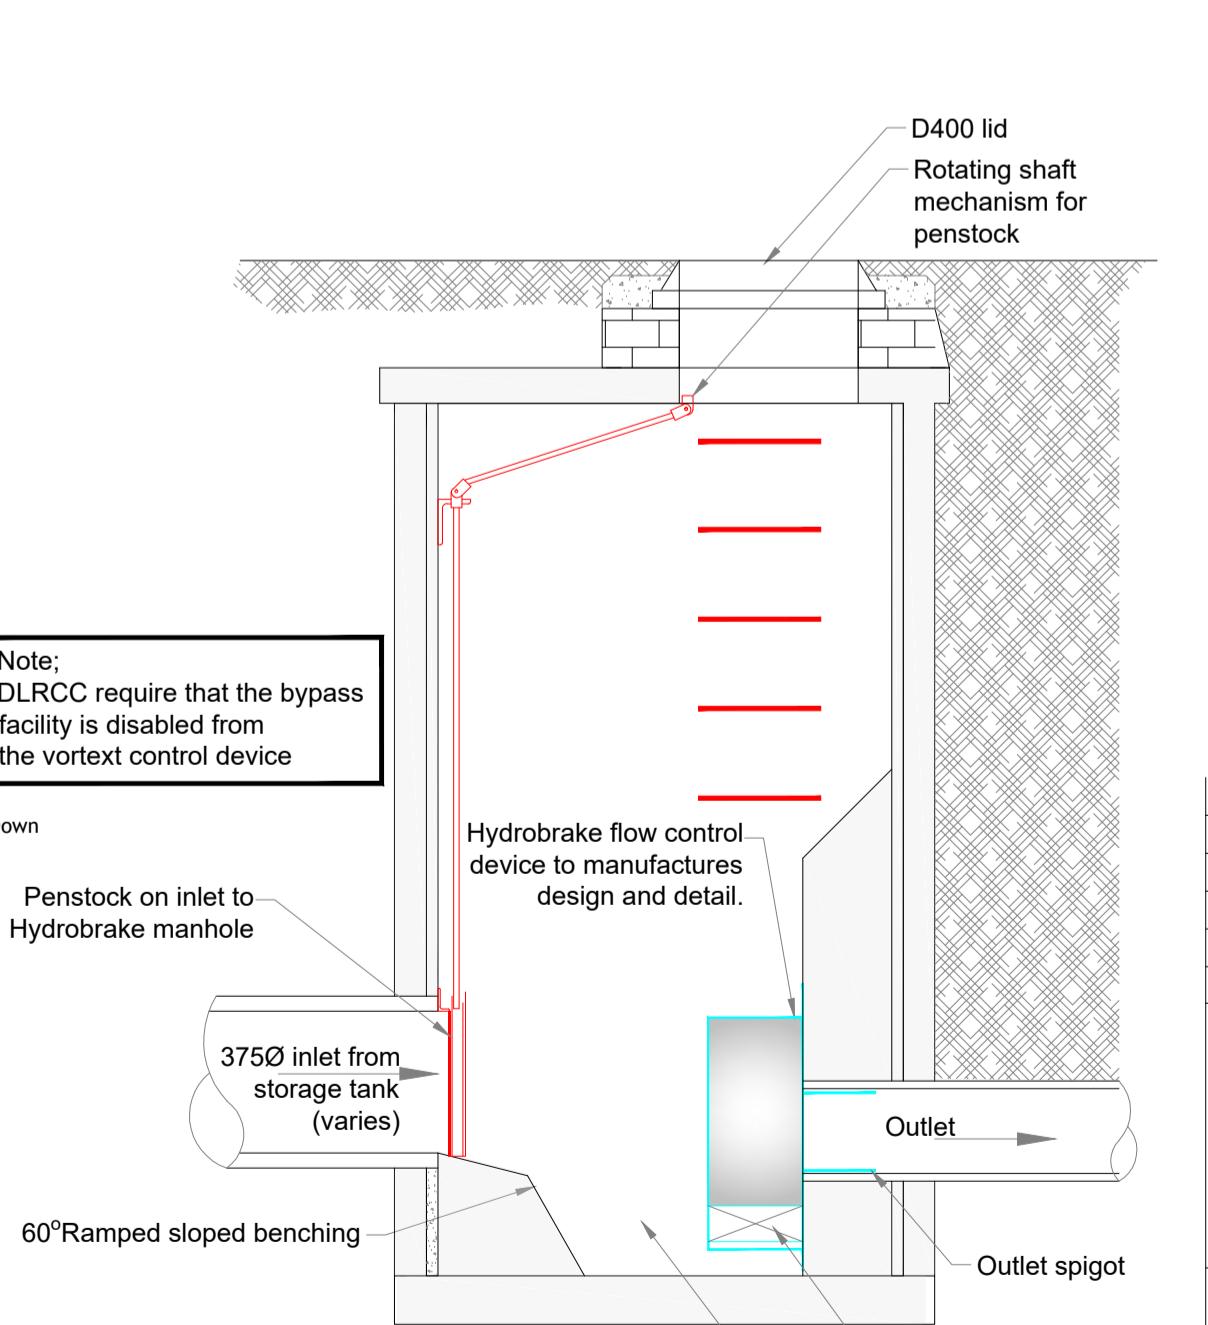

ELEVATION (SAFETY CHAIN, HOOK & EYE)

NTS

Typical Hydrobrake Manhole

Scale 1:20

REV DATE DESCRIPTION  
ROGER MULLARKEY & ASSOCIATES  
Consulting Structural and Civil Engineers  
Duncock, Kilcock, Co.Kildare  
Tel: +353 1 610 3755 Mob: +353 87 232 4917  
E-mail: info@rmullarkey.ie www.rmullarkey.ie

Project  
GLENAMUCK NORTH  
Drawing Title  
MANHOLE DETAILS  
Architect  
MCORM  
Architects  
Date Drawn By Scales Dwg.No. Stage  
Mar'25 RM As Shown @A1 2411/115 Stage 3  
LRD Rev